





h 1800

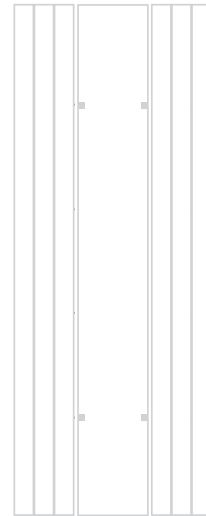

	straight
Material	carbon steel
Pipes - mm	70x11x1,5
Collectors - Ø	35x1,5
Connections	6x1/2' *
Wall fixings	4
Max pressure	4 bar
Max temperature	90 °C
Paint	epoxypolyester powder
Packaging	nylon bag + styrofoam protections + carton box
* air bleeding valve connection, included	

Standard equipment: 1 kit wall fixing brackets - 1 air bleeding valve

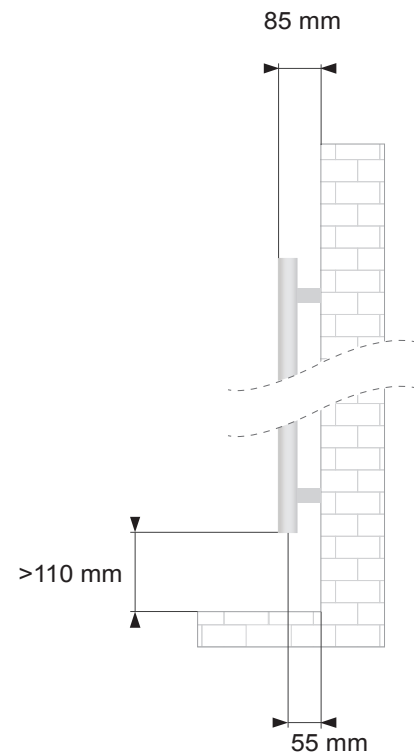

White RAL 9016


code	h mm	width mm	interaxis N1 mm	interaxis N2 mm	interaxis N3 mm	weight kg	water lt	$\Delta T 50^{\circ}C$ watt ϕ 75/65/20°	$\Delta T 42,5^{\circ}C$ watt ϕ 70/55/20°	$\Delta T 30^{\circ}C$ watt ϕ 55/45/20°	$\Delta T 50^{\circ}C$ kcal/h	$\Delta T 60^{\circ}C$ btu	elements	$\Delta T 50^{\circ}C$ exponent n
383852	1800	600	1750	600	50	23,1	4,7	674	549	353	580	2901	4	1,26960
383853	1800	750	1750	750	50	26,8	7	955	777	498	822	4112	6	1,27434

Anthracite VOV 12

code	h mm	width mm	interaxis N1 mm	interaxis N2 mm	interaxis N3 mm	weight kg	water lt	$\Delta T 50^{\circ}C$ watt ϕ 75/65/20°	$\Delta T 42,5^{\circ}C$ watt ϕ 70/55/20°	$\Delta T 30^{\circ}C$ watt ϕ 55/45/20°	$\Delta T 50^{\circ}C$ kcal/h	$\Delta T 60^{\circ}C$ btu	elements	$\Delta T 50^{\circ}C$ exponent n
383854	1800	600	1750	600	50	23,1	4,7	674	549	353	580	2901	4	1,26960
383855	1800	750	1750	750	50	26,8	7	955	777	498	822	4112	6	1,27434

Chrome

code	h mm	width mm	interaxis N1 mm	interaxis N2 mm	interaxis N3 mm	weight kg	water lt	$\Delta T 50^{\circ}C$ watt ϕ 75/65/20°	$\Delta T 42,5^{\circ}C$ watt ϕ 70/55/20°	$\Delta T 30^{\circ}C$ watt ϕ 55/45/20°	$\Delta T 50^{\circ}C$ kcal/h	$\Delta T 60^{\circ}C$ btu	elements	$\Delta T 50^{\circ}C$ exponent n
383856	1800	600	1750	600	50	23,1	4,7	419	361	215	339	1819	4	1,31404
383857	1800	750	1750	750	50	26,8	7	573	469	304	493	2454	6	1,24410

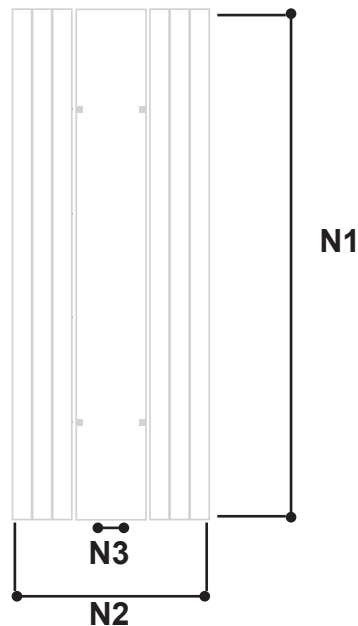

Our radiators are tested in qualified laboratories according to EN-442 regulations which determine the output value by fixing the ΔT at $50^{\circ}C$. ΔT is the difference between the average temperature of the water inside the radiator and the room temperature. The formula is: $((T_1+T_2)/2)-T_3$.

Ex.: $((75+65)/2)-20 = 50^{\circ}C$. For output values with a different ΔT use the following formula: $\phi_x = \phi_{\Delta T 50} * (\Delta T_x / 50)^n$.

See calculation example of the output at $\Delta T 60^{\circ}$ of article 383856: $419 * (60/50)^{1,31404} = 533$.

Output values in kcal/h = watt x 0,85984. Output values in btu = watt x 3,412.

LEGEND

T_1 = supply temperature - T_2 = return temperature - T_3 = room temperature.

ϕ_x = output to be calculated - $\phi_{\Delta T 50}$ = output at $\Delta T 50^{\circ}C$ (table) - ΔT_x = ΔT value to be calculated - n = exponent "n" (table).